


Getting started with your SmartRooms Comfort Controller is as easy as ... 1,2,3.

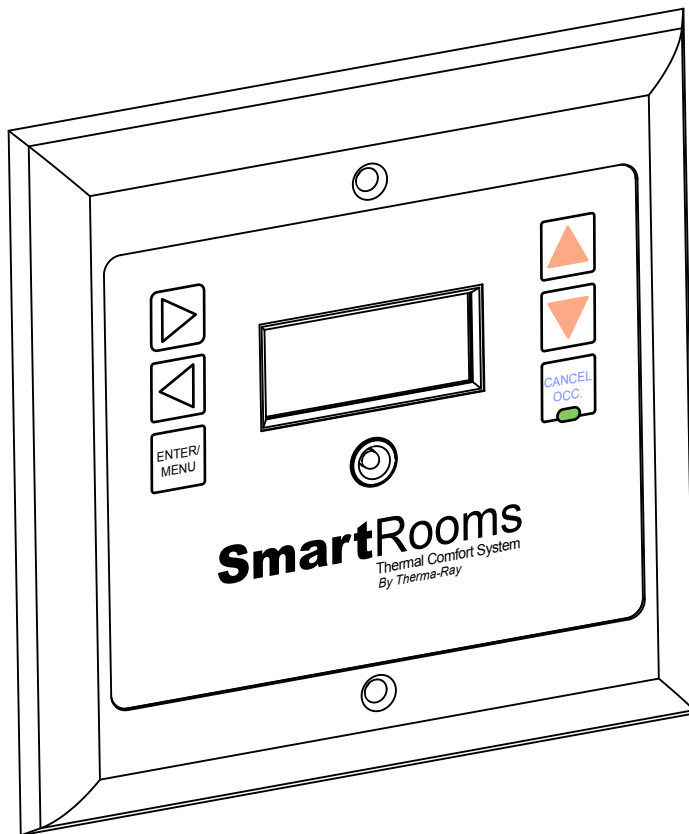

- 1** Press **Cancel/Occ.** to put Comfort Controller in manual mode
- 2** Verify that the green light is on indicating manual mode.
- 3** Choose the desired room temperature using the **Up** or **Down** arrows. You can change this temperature at any time.

Notes:


- ° Your System is calling for heat when an arrow is displayed.
- ° Your System will turn ON when the temperature difference between the Comfort Settings and the actual floor temperature is more than 2° Fahrenheit (1° Celsius).

SmartRooms
Thermal Comfort System
By Therma-Ray

SmartRooms

Thermal Comfort System

By Therma-Ray

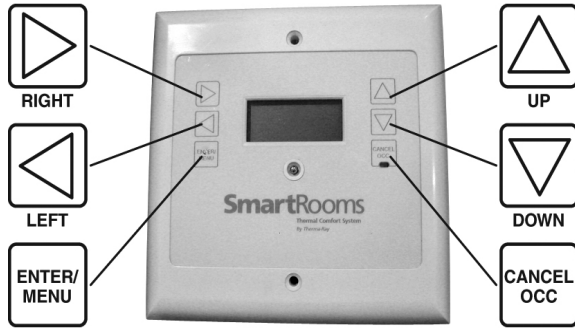

Whether you're a contractor, architect, builder or homeowner, creating the perfect indoor environment has always been a challenge. Therma-Ray, the world's #1 name in thermal comfort systems, introduces you to the ultimate solution: SmartRooms. Please take the time to read this operation guide carefully before you begin. A diagram of the menu display system is found at the end of this guide for easy reference.

COMFORT CONTROLLER LINE VOLTAGE (240/120) Owners Manual

SmartRooms Comfort Controller displays the current time and room temperature. It also displays the day of the week and the given temperature set point. It is programmable and operational in both English and French. See the Secondary Features section on Page '3/6' to set language preference.

Set Date			Set Time		
Press		Display	Press		Display
1. ENTER/MENU	→	MENU DATE	1. ENTER/MENU	→	MENU DATE
2. ENTER/MENU	→	MM/DD/YY 03/01/03	2. DOWN	→	MENU TIME
3. LEFT, RIGHT	Select MM, DD or YY	MM/DD/YY 03/01/03	3. ENTER/MENU	→	HH:MM 10:32AM
4. UP, DOWN	Set Numbers	MM/DD/YY 03/01/03	4. LEFT, RIGHT	Select HH or MM	HH:MM 10:32AM
5. ENTER/MENU	→	MENU DATE	5. UP, DOWN	Set Numbers	HH:MM 10:45AM
6. CANCEL OCC.	→	10:30AM 23.3C	6. ENTER/MENU	→	MENU TIME
			7. CANCEL OCC.	→	10:45AM 23.3C

Set Daily Programs

Use this function to program your temperature set points for each day of the week. The controller accepts up to five set points per day, the first starting at 12:00am, the last finishing at 11:59pm.

- | | Press | | Display |
|-----|-------|-------------------------|--------------------------|
| 1. | | → | MENU
DATE |
| 2. | X4 | → | MENU
SCHEDULE |
| 3. | | → | WEEKDAY
SUNDAY |
| 4. | | → | MENU
PROG 01 |
| 5. | | → | ALWAYS START
12:00 AM |
| 6. | | → | ENDS AT:
06:00 PM |
| 7. | | →
Select
HH or MM | ENDS AT:
06:00 PM |
| 8. | | →
Set
End Time | ENDS AT:
08:00 AM |
| 9. | | → | FLOOR
20.0 C |
| 10. | | →
Set
Floor Temp | FLOOR
18.0 C |
| 11. | | → | MENU
PROG 02 |

Repeat steps 5-10 until you reach program 5 or until you reach 11:59PM.

To copy all the programs from Sunday to the rest of the six remaining days:

- | | | | |
|----|--|---|------------------|
| 1. | | → | MENU
SCHEDULE |
| 2. | | → | MENU
COPYDAYS |

Set Daily Programs (Cont'd)

- | | Press | | Display |
|----|-------|---|-----------------------|
| 3. | | → | COPYING
WAITING... |

Note: "Copy Days" saves you programming time. If you prefer your weekdays programmed differently from the weekend, program Sunday as if it were Monday. Use "Copy Days" to make all days the same then return to step 4 and modify the weekend program.

Ready to Operate

After setting all of your day's programs your SmartRooms Comfort Controller is ready to start operating on its own. If at any time you wish to override your day program temperature settings, you can easily press the **Cancel/Occ** button to activate the Occupied Temperature Override. The light below the button will be on when the override is activated. Pressing the **Cancel/Occ** button again will reactivate the regular schedules. Should you forget to cancel the override, the SmartRooms Comfort Controller will remain in Manual Mode - your programmed schedule will not become activated. The occupied temperature setting can also be easily changed by pressing the **Up** and **Down** arrows when your time, date and temperature are being displayed.

Set Occupied Temp

Use this function to set the default room temperature when you choose to override your daily programs. To override the daily programs, press the Occupied button to set the controller in manual mode (Green LED on).


- | | Press | | Display |
|----|-------|------------------|------------------|
| 1. | | → | MENU
DATE |
| 2. | X2 | → | MENU
OCCUPIED |
| 3. | | → | MENU
25.0 C |
| 4. | | →
Set
Temp | MENU
20.0 C |
| 5. | | → | MENU
UPDATED. |
| 6. | | → | 10:30AM
23.3C |

Use this chart to keep track of your preferred program schedules.
Enter the program end-time and desired temperature in each of the given boxes.







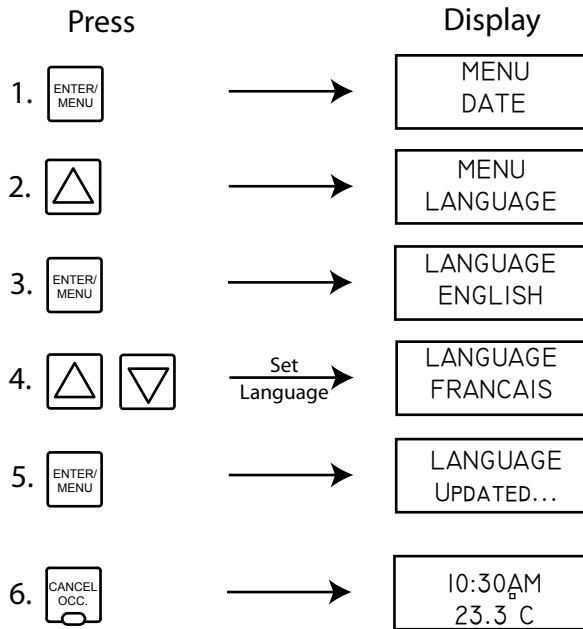

Day	Prog1 time	Prog1 temp	Prog2 time	Prog2 temp	Prog3 time	Prog3 temp	Prog4 time	Prog4 temp	Prog5 time	Prog5 temp
Sun										
Mon										
Tue										
Wed										
Thu										
Fri										
Sat										

Secondary Features

Set Language



Set Time Format

Press	Display
1. 	MENU DATE
2.  x 3	MENU SETUP
3. 	SETUP TIME FMT
4. 	TIME FMT AM/PM
5.   → <u>Set Format</u>	TIME FMT 24 HR
6. 	TIME FMT UPDATED...
7.  x 3	10:30AM 23.3C

Set Mode








This option needs to be set as it allows you to input which system (Floor, Ceiling, or ETS) or systems are being controlled by this particular controller.

BOTH - Ceiling and Floor Systems



ES + DHW - Earth Storage and Domestic Hot Water

FLOOR - Floor System Only










CEILING - Ceiling System Only

Press	Display
1. 	MENU DATE
2.  x 3	MENU SETUP
3. 	SETUP TIME FMT
4. 	SETUP MODE
5. 	MODE BOTH
6.   → <u>Set Mode Ex. 'Floor'</u>	MODE FLOOR

Set Mode (cont'd)




Press	Display
7. 	MODE UPDATED
8.  x 3	10:30AM 23.3C

Set Temp Scale

Press	Display
1. 	MENU DATE
2.  x 3	MENU SETUP
3. 	SETUP TIME FMT
4.  x 2	SETUP SCALE ?
5. 	SCALE ? CENTI
6.   → <u>Set Scale</u>	SCALE ? FAHREN
7. 	SCALE ? UPDATED...
8.  x 2	22:30 70°F


Set Vacation Temp

Use this function to program the temperature set point used by the vacation function.

Press	Display
1. 	MENU DATE
2.  x 3	MENU SETUP
3. 	SETUP TIME FMT


Secondary Features (Continued)

Set Vacation Temp (Cont'd)

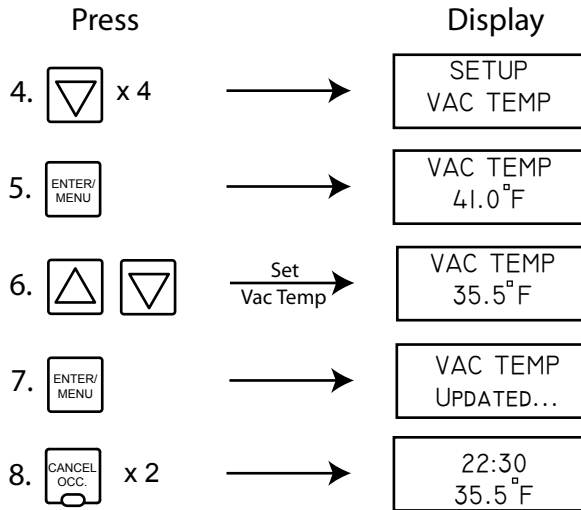



Activate Vacation Temp

Use this function to override your programs. This function is especially useful when you go on vacation and you want to keep your residence at a constant low temperature to save on energy costs.

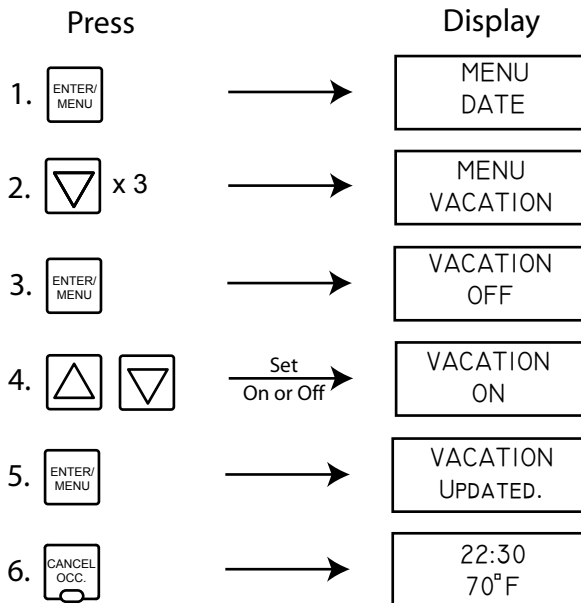

Set Daylight Savings Time

This function is factory set to ON. If your area does not use daylight savings time, set to OFF.

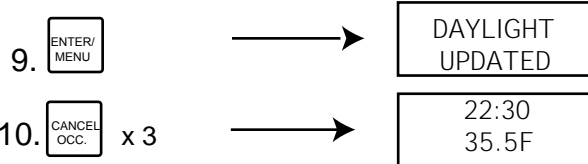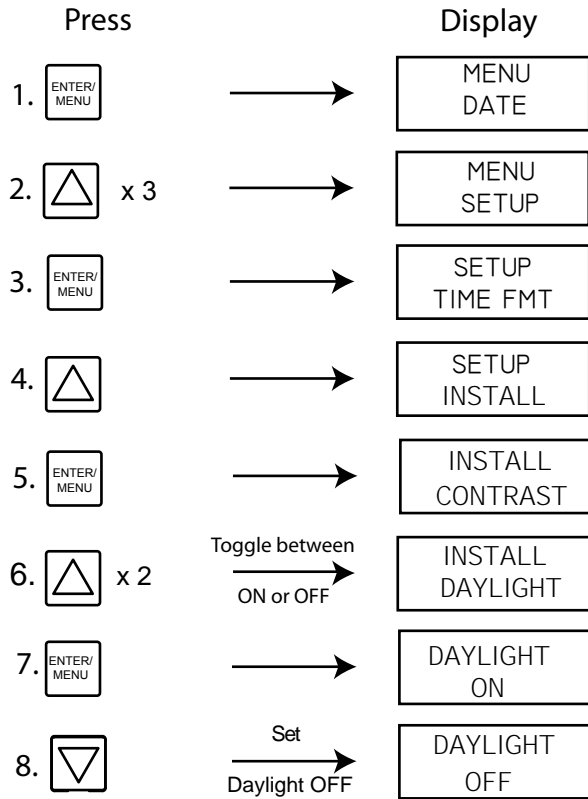

Secondary Features (Continued)

Multiple Sources Options

Testing / Viewing Current Temperature Readings From Available Sources - To test / view the currently read temperatures from both the ceiling and the floor sensors, go to the **Menu** screen, select **Setup** from the options, then scroll to the **Sensors** option. Select the option, press **Enter/Menu** and with the "Up and Down" arrows, you can choose which sensor for which you wish to view the reading. Once you are done, press the **Cancel/Occ** button until you have returned to the "Time/Date/Temperature" display screen.

High Limit Temperature - Do not change this feature. It is used for ETS, Ceiling and other special applications.

Selecting The Appropriate Sensor - You can set the SmartRooms Controller to measure temperatures from either the Floor sensor, Ceiling (onboard sensor) or both. To toggle between these three options, go into the **Menu** screen and scroll through to the **Mode** option. Press **Enter/Menu** to choose the option and press the "Up and Down" keys to toggle. Press the **Enter/Menu** button again to accept the changes.

Note: If you do not have a floor sensor installed, the controller will see it's not present and be shut off, thus disabling temperature control. The **Both** option is only functional with the Low Voltage System. For use with the Earth Storage System, the floor sensor is the one to use.

Ground Fault Circuit Interrupter (GFCI) - A separate GFCI breaker is required when using the floor warming system.

To Lock the Thermostat, go to MENU - >LOCK and press the MENU key. System is now locked. Only 'override' is enabled in this mode. Pressing MENU key when locked will show SYSTEM LOCKED then it will ask you for a CODE ? Use the "Up and Down" keys to enter a code.

There are two codes to enter: first one is 12 then press MENU key, cursor will show another number to enter, 2nd Code is 06. Any other combinations will lock system.

Ground Fault Circuit Interrupter (GFCI) - A separate GFCI breaker is required when using the floor warming system.

Troubleshooting

Use the following information to troubleshoot your comfort controller.

Room T* - This indicates that the floor sensor is not working and could be damaged. No need to worry, your SmartRooms Controller has a back up sensor located in the face plate.

Your floor warming system will continue to function normally.

You may want to do one of the following:


A) Remove the face plate and check to see if the sensor is properly connected to the back of the face plate.

B) Leave everything as is.

C) Replace the sensor. To do this you will likely have to remove tiles. Caution should be taken not to damage the heating cable.

Garbled Screen - Press 'Menu', if this does not work, unplug the controller, wait a few minutes and plug it in again.

No Answer - This is a remote function error. Check that the thermostat is firmly plugged in.

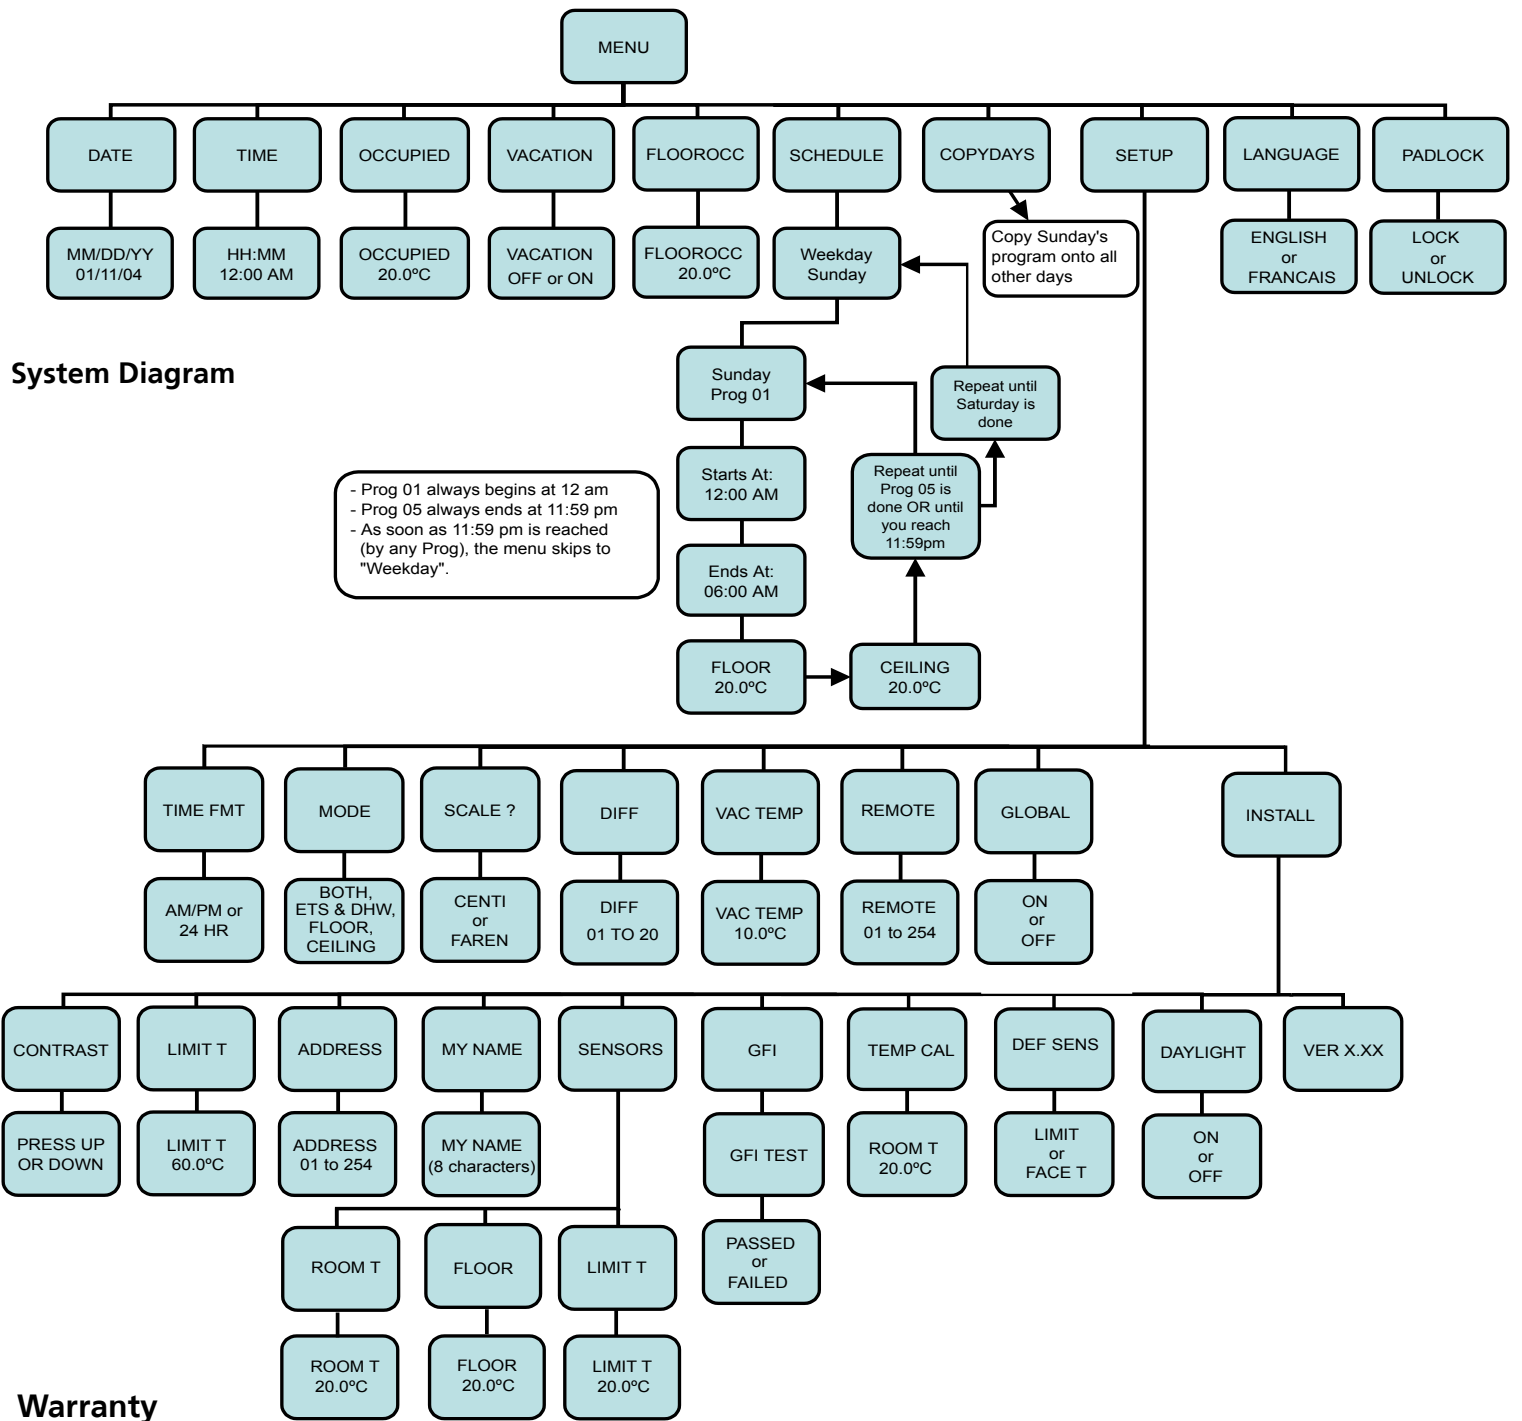

Therma-Ray Inc. one (1) Year Limited Warranty. Therma-Ray Inc. warrants the controller is free of defects in material and workmanship after proper installation for a one (1) year period from the date of installation. During this period, Therma-Ray Inc. will replace or repair the controller without charge if it has been used under normal conditions. This warranty does not cover delivery costs. The warranty does not apply if poorly installed or damaged after installation. Therma-Ray Inc. will not compensate for consequential damage, direct or indirect, resulting from the failure of the controller. All other representations, warranties and conditions, whether oral or written, express or implied, statutory or otherwise are expressly excluded. The defective controller must be returned to the place of purchase or sent prepaid to Therma-Ray Inc.

Therma-Ray Inc.

670 Wilsey Road, Fredericton, NB
 Canada E3B 7K4
 Tel: 506-457-4600 Fax: 506-457-4699
 E-mail: sales@thermaray.com

www.thermaray.com

Printed in Canada

SmartRooms

Thermal Comfort System
 By Therma-Ray